


# Multipure's Superior Performance Confirmed by Testing and Certification

The effectiveness of any drinking water treatment device is measured by the performance of its filter. NSF testing in accordance with NSF/ANSI standards provides the consumer with the highest level of assurance that certified products will perform as claimed. A close review of NSF Listings shows that Multipure's solid carbon block filters are the most effective for reducing a broad spectrum of contaminants of aesthetic as well as health concern.


## NSF Listings by Standard

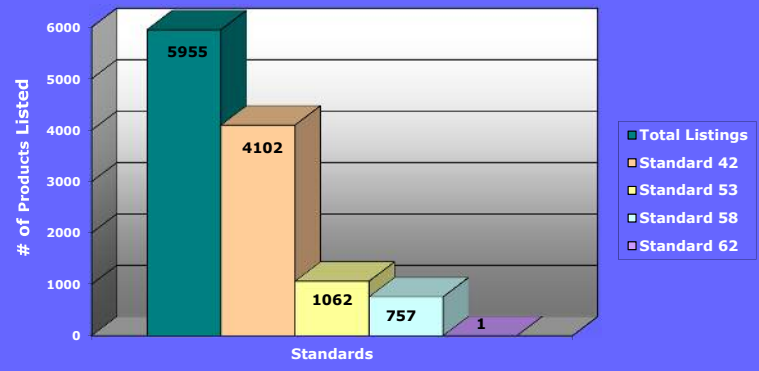

NSF Online Listings  
August 15, 2012

**Chart A**


## NSF Listings by Single Contaminant

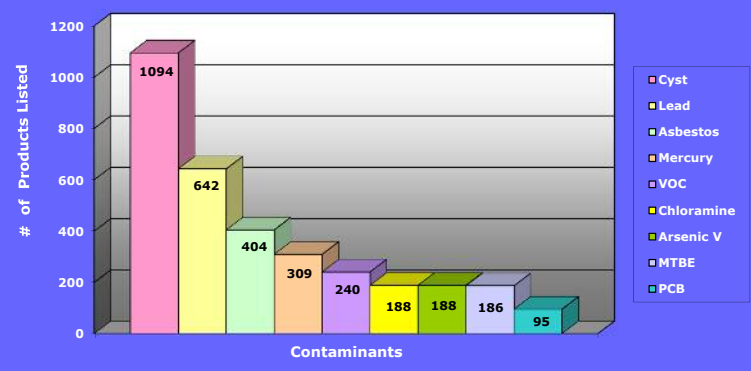

NSF Online Listings  
August 15, 2012

**Chart B**


## Listings by Combinations of Contaminants

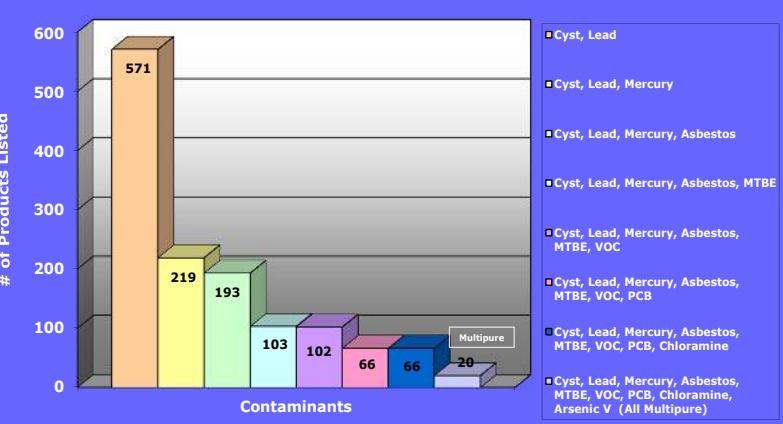

NSF Online Listings  
August 15, 2012

**Chart C**

## Manufacturers by Combinations of Contaminants

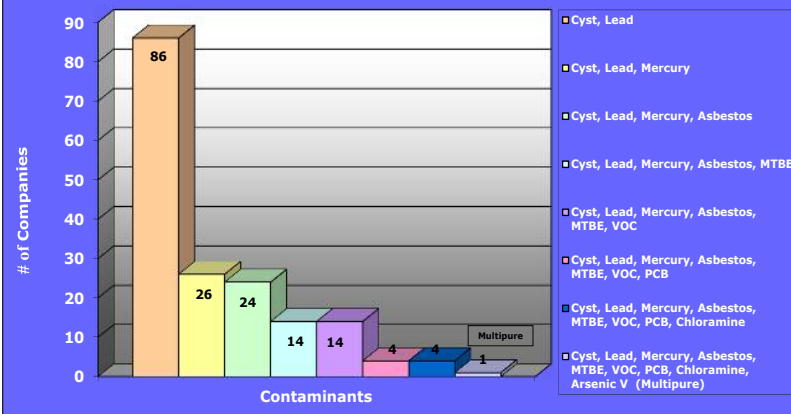

NSF Online Listings  
August 15, 2012

**Chart D**

# Comparing Drinking Water Systems Certified Performance Says It All

Testing programs and standards developed by NSF International provide a basis for evaluating and comparing drinking water treatment units. Although thousands of drinking water systems have been tested and certified, only a few are certified to reduce a wide range of contaminants. These charts summarize NSF Listings by standard, by single contaminants, and by combinations of contaminants.

Only Multipure Drinking Water Systems are certified to reduce Lead, Mercury, Cyst, Asbestos, VOC, MTBE, PCB, Chloramine, and Arsenic V. By carefully reviewing the certification of a product, consumers can make an informed decision about the drinking water treatment device that will provide the performance they need.

## NSF Listings by Standard - Chart A

By Standard	Products
Aesthetics, Standard 42	4102
Health Effects, Standard 53	1062
Reverse Osmosis, Standard 58	757
Distillation, Standard 62	1
<b>Total</b>	<b>5922</b>

## NSF Listings by Contaminant - Chart B

By Single Contaminants	Health Effects	Reverse Osmosis	Distillers	Total
Chlorine	1667	0	0	1667
Cyst	913	181	0	1094
Lead	464	177	1	642
Asbestos	390	14	0	404
Mercury	309	0	0	309
VOC	227	13	0	240
Arsenic	21	166	1	188
Chloramine	188	0	0	188
MTBE	186	0	0	186
PCB	95	0	0	95

## NSF Listings by Combinations of Contaminants - Chart C

By Combination of Contaminants	Number of Products			
	Health Effects	Reverse Osmosis	Distillers	Total
Cyst, Lead	395	176	0	571
Cyst, Lead, Mercury	219	0	0	219
Cyst, Lead, Mercury, Asbestos	193	0	0	193
Cyst, Lead, Mercury, Asbestos, MTBE	103	0	0	103
Cyst, Lead, Mercury, Asbestos, MTBE, VOC	102	0	0	102
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB	66	0	0	66
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramine	66	0	0	66
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramines, <b>Arsenic V</b>	20	0	0	20

All 20 models  
Multipure

## NSF Listings by Manufacturers by Combinations of Contaminants - Chart D

By Combination of Contaminants	Number of Companies			
	Health Effects	Reverse Osmosis	Distillers	Total
Cyst, Lead	50	36	0	86
Cyst, Lead, Mercury	26	0	0	26
Cyst, Lead, Mercury, Asbestos	24	0	0	24
Cyst, Lead, Mercury, Asbestos, MTBE	14	0	0	14
Cyst, Lead, Mercury, Asbestos, MTBE, VOC	14	0	0	14
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB	4	0	0	4
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramine	4	0	0	4
Cyst, Lead, Mercury, Asbestos, MTBE, VOC, PCB, Chloramines, <b>Arsenic V</b>	1	0	0	1

Multipure

Charts are based on NSF online listings on August 15, 2012  
For more information, go to NSF International website: [www.nsf.org](http://www.nsf.org)



### Multipure Drinking Water Systems

The Las Vegas Technology Center

7251 Cathedral Rock Drive

Las Vegas, NV 89128

800.622.9206

[www.multipure.com](http://www.multipure.com)